


240 Volt 1 Phase
30 amp Service

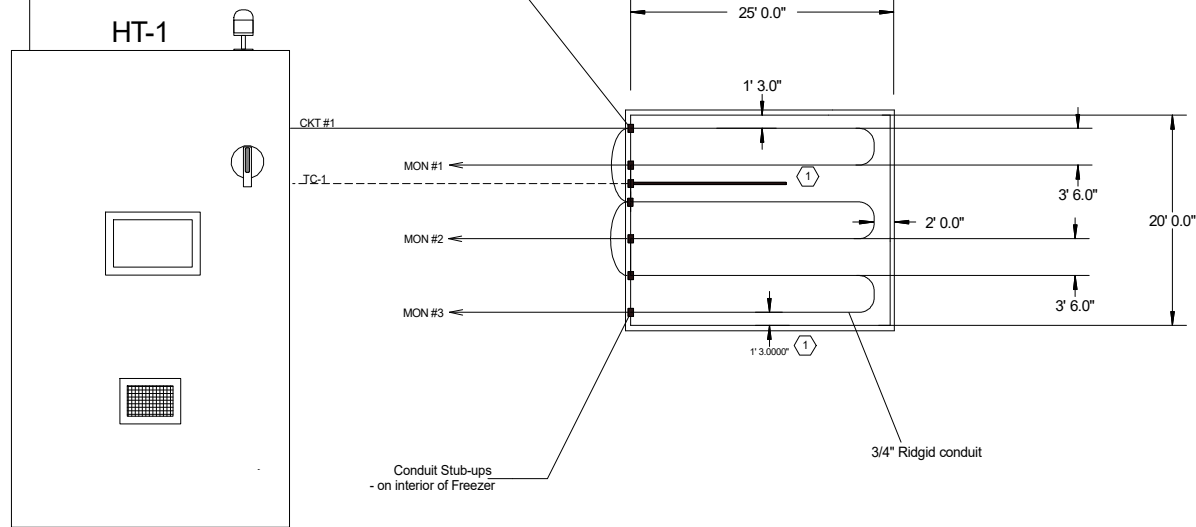

General Notes

① Sensor Conduit
3/4" Rigid
Cap end, 13' Long

Swain and Associates
-0° F 25' x 20' Freezer
240 / 1 Phase
30 amps

REV1

Circuit #1, - (2) runs each Heat trace 240 Volts, 6.2 amps - inrush up to 20 amps each. Home runs to HT-1
 Circuit #2, - (2) runs each Heat trace 240 Volts, 6.2 amps - inrush up to 20 amps each. Home runs to HT-1

Monitor # 1-3- End Run Monitor Circuits Typical , Less than 1 amp, Home run to panel HT-1

Sensor #TC1 - Type J Thermocouple 35' leads, use 20 Gauge PVC / PVC Type J extension grade wire only To HT-1